

# Cable routing plan

Product name: Resistent  
Version number: 01



**Genau  
mein  
Klima.**

**KAMPMAN**

## **Information on cable laying:**

The following information on cable types and cable laying must be observed in compliance with VDE 0100.

The installation, operation and maintenance of these devices must comply with the country-specific applicable laws, standards, regulations and directives.

Without \*: NYM-J. The required number of cores incl. protective conductor is indicated on the cable. Cross sections are not indicated, as the cable length is included in the calculation of the cross section.

\*): Shielded cable, J-Y(ST)Y 0.8mm. Lay separately from power lines.

\*\*) : Shielded cable stranded in pairs, e.g. UNITRONIC® BUS LD 2x2x0.22, UNITRONIC® BUS LD 3x2x0.22. Install separately from power lines.

- If other cable types are used, they must be at least equivalent.

- The connection terminals on the device are suitable for a maximum wire cross-section of 2.5 mm<sup>2</sup>, the mains plug for max. 4.0 mm<sup>2</sup>.

- When using residual current circuit breakers, these must be at least mixed frequency sensitive (type F). For the design of the rated residual current, the specifications from DIN VDE 0100 Parts 400 and 500 must be observed.

- For the design of the on-site mains supply and fuse protection (C16A, max. 10 devices), the electrical data in the table below must be observed.


- Lines for data or bus signals are shown with shield connected at one end. Lines for analog signals are shown with the shield not connected. Due to structural or local conditions and depending on the type and level of interference, which can be caused by magnetic and/or electric fields in high and/or low frequency ranges, among other things, a different connection of the shield (connected at both ends or not connected) may be necessary. This must be checked by the customer and, if necessary, carried out deviating from the specifications in the documentation!


### **Electromechanical:**


- Cable length between speed controller and the last device: maximum 100 m, from 20 m connect shield on one side.


- Cable length between room thermostat and temperature sensor or switch contact: maximum 50 m.


- Cable length between speed controller and temperature sensor or switching contact: maximum 100 m.


	Bearbeiter:	Projekt: Test, Ort	General Information	Blatt-Nr.:	 Genau mein Klima.
	Erstelldatum: 06.02.2024	Projekt-Nr.:		2 von 11	

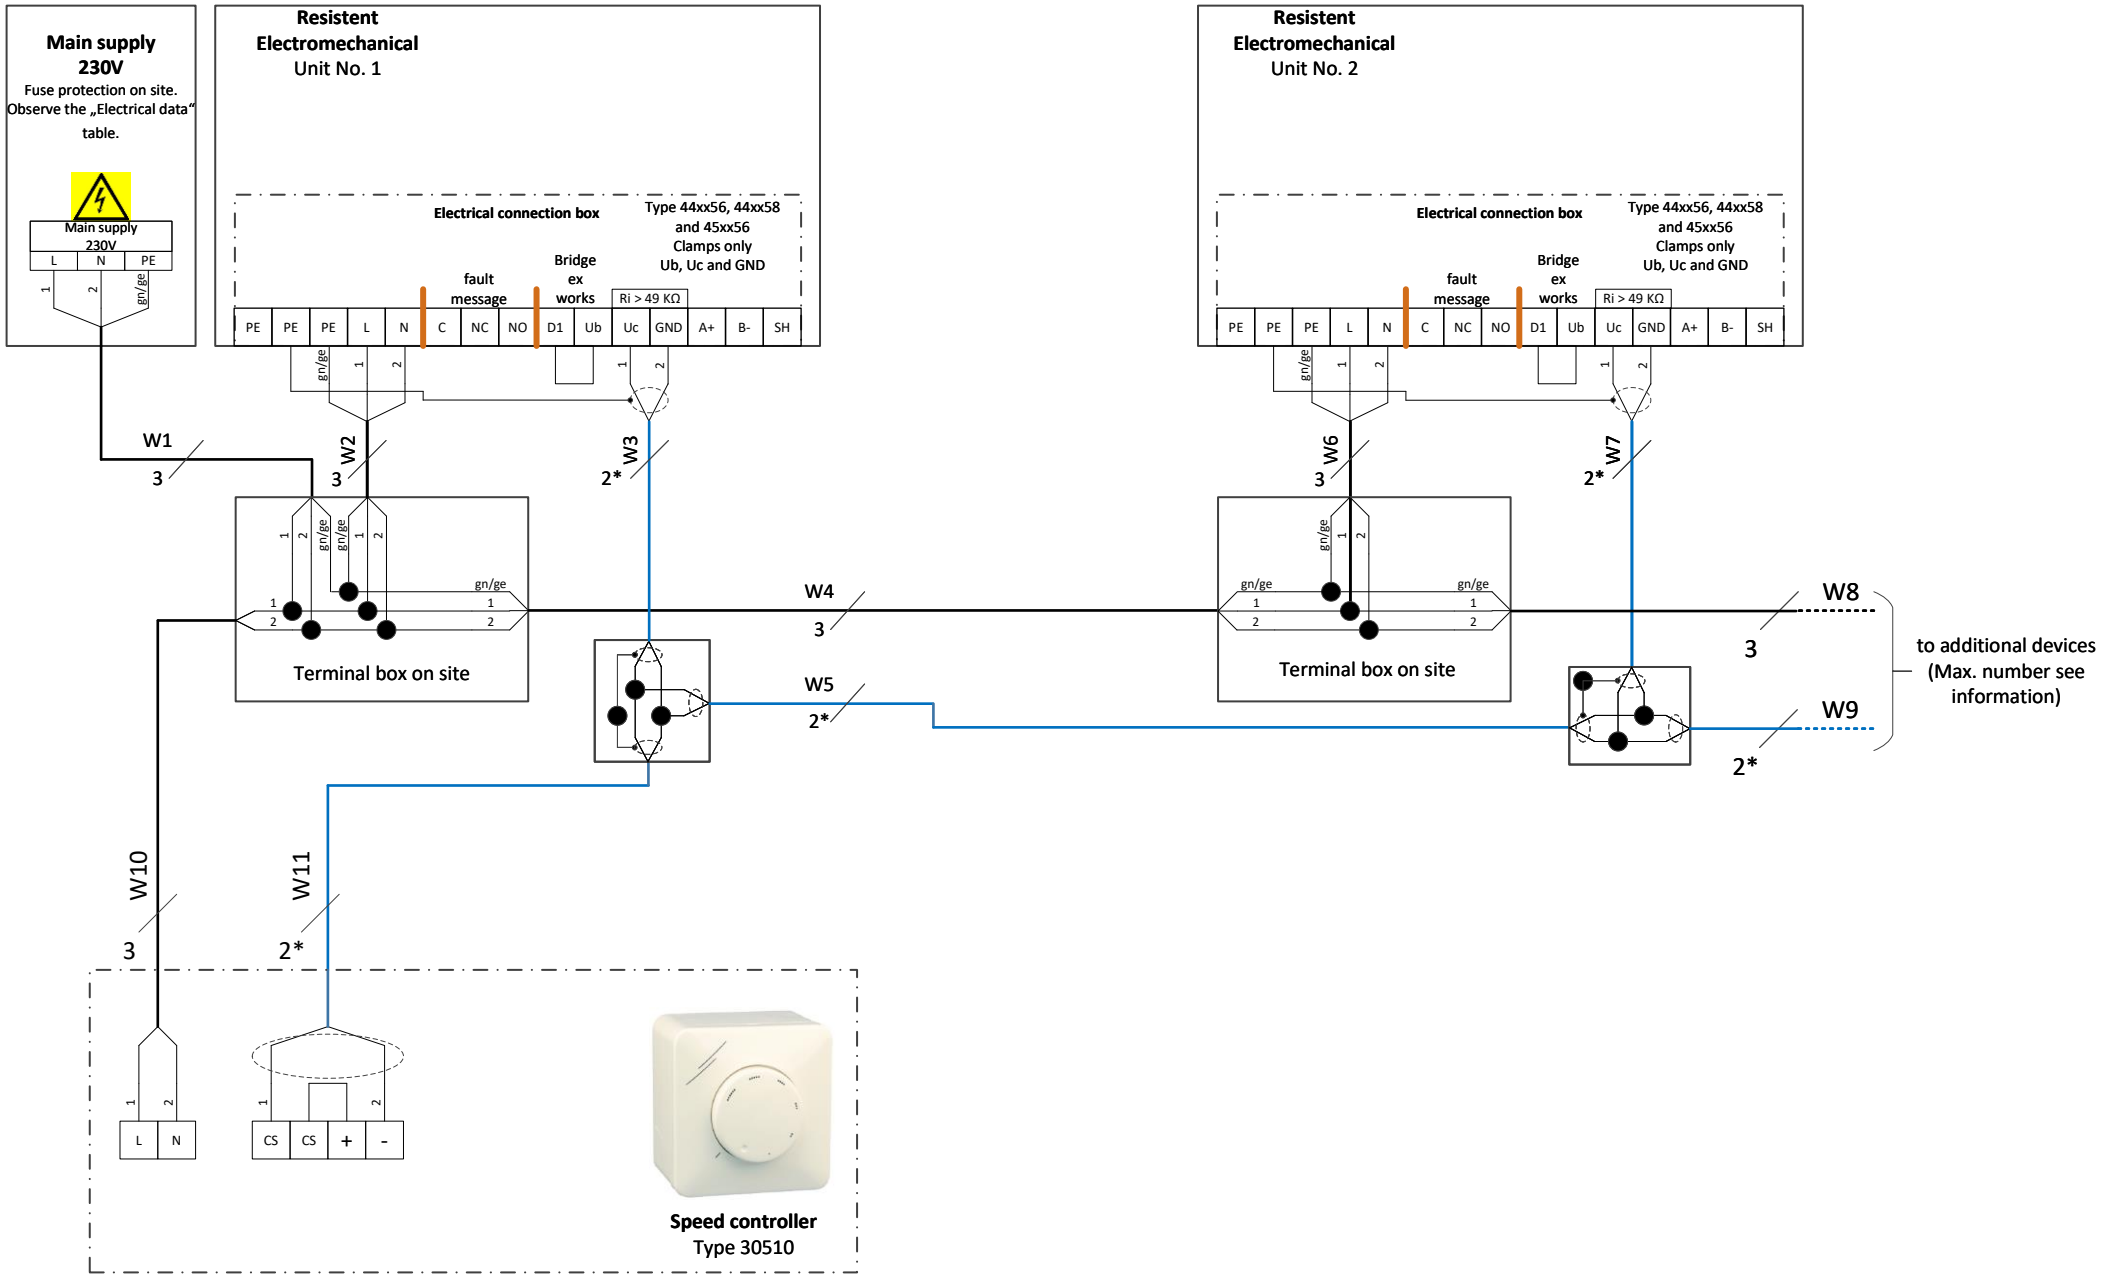


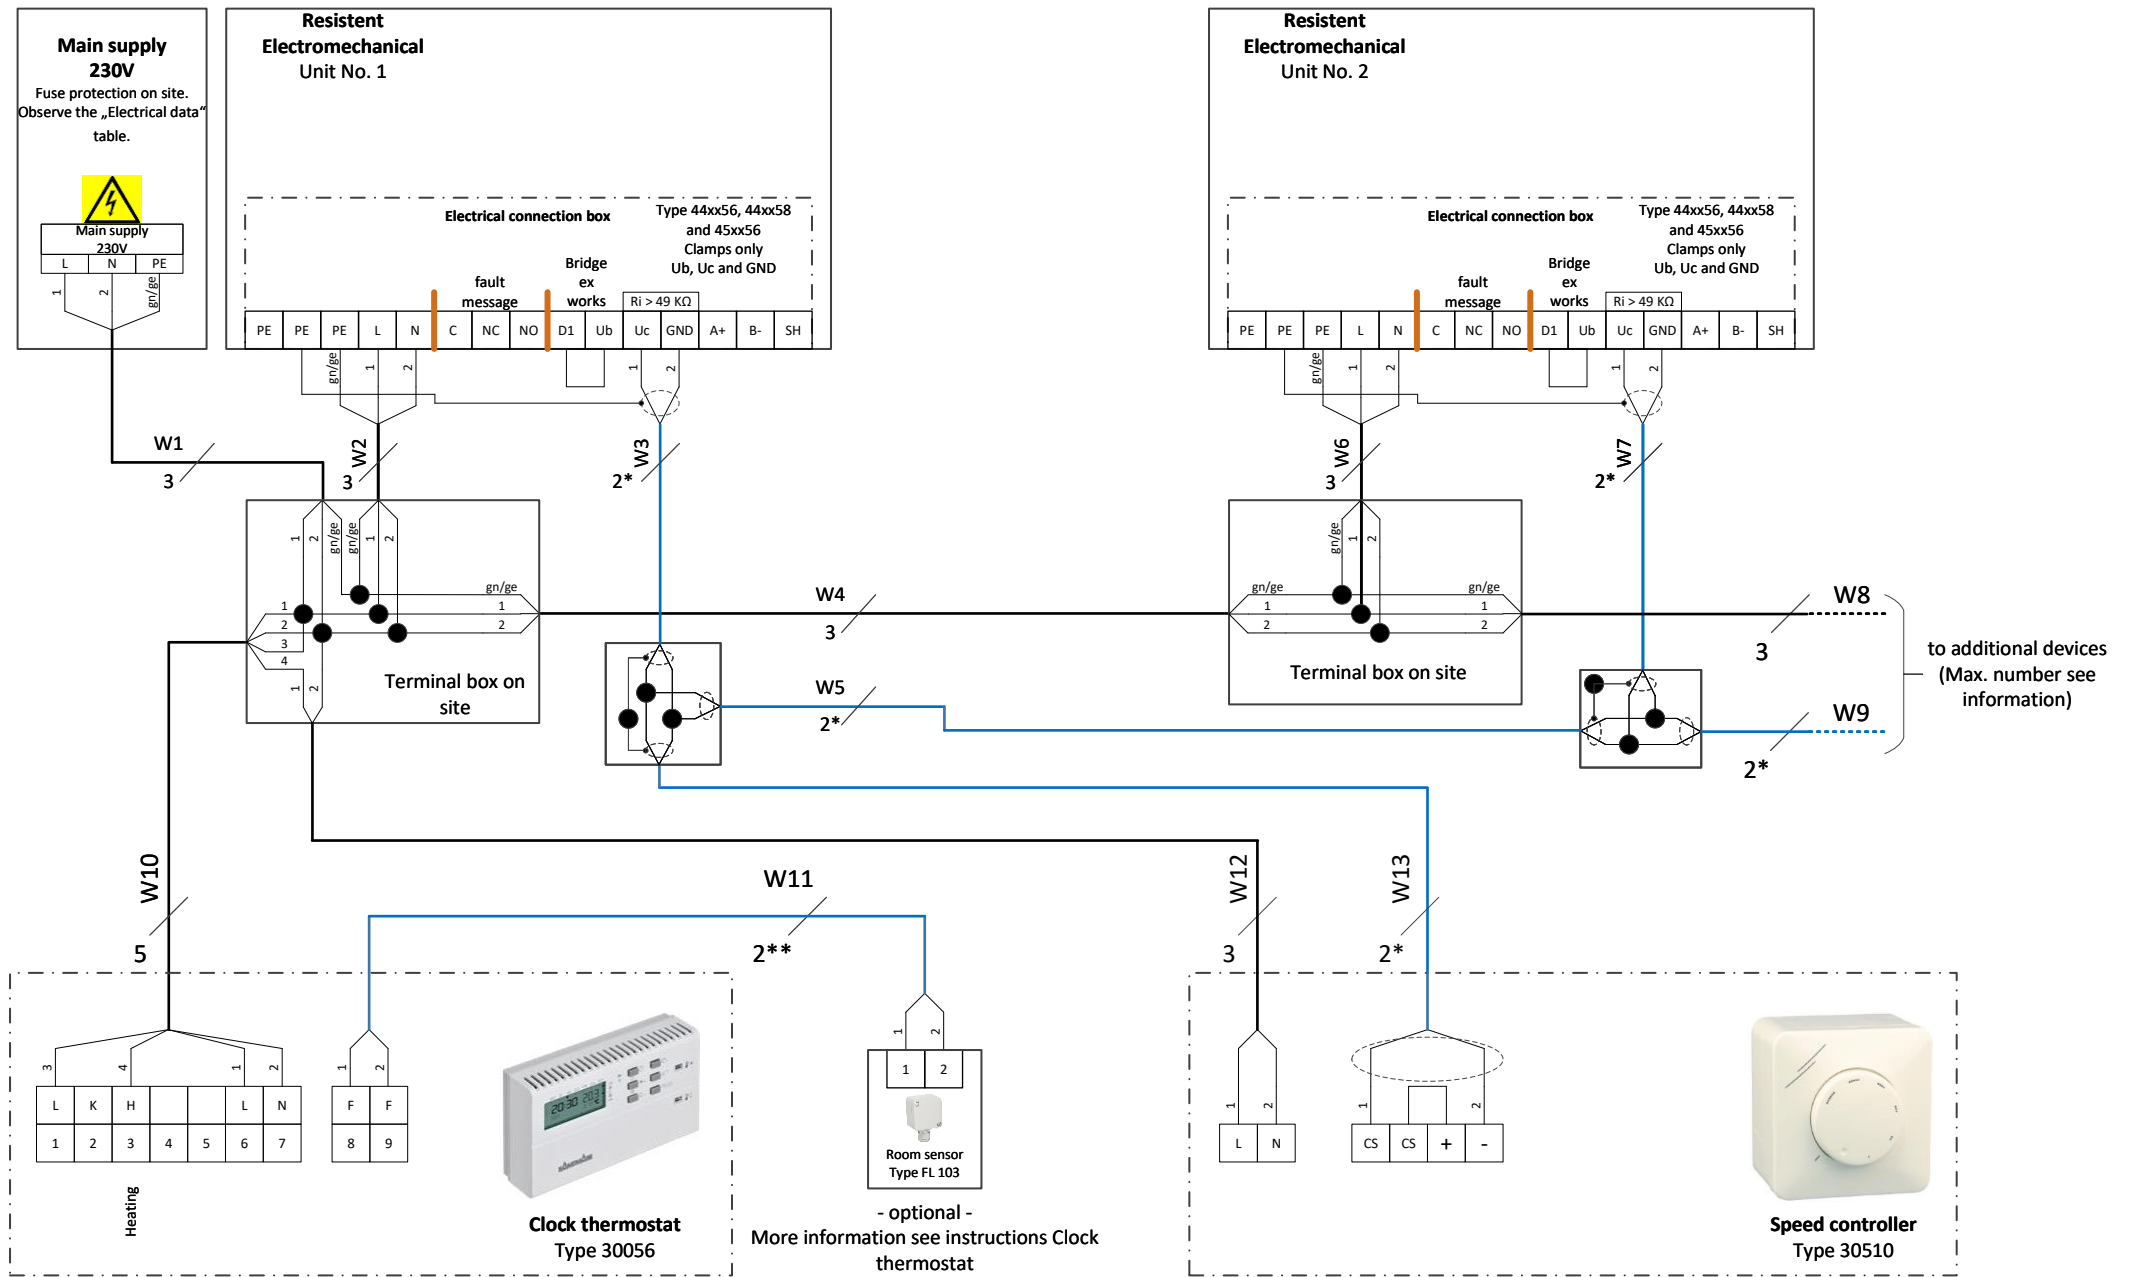
	Bearbeiter:	Projekt: Test, Ort	Resistent, electromechanical, Speed controller Type 30510	Blatt-Nr.:	 Genau mein Klima.
	Erstelldatum: 06.02.2024	Projekt-Nr.:		3 von 11	

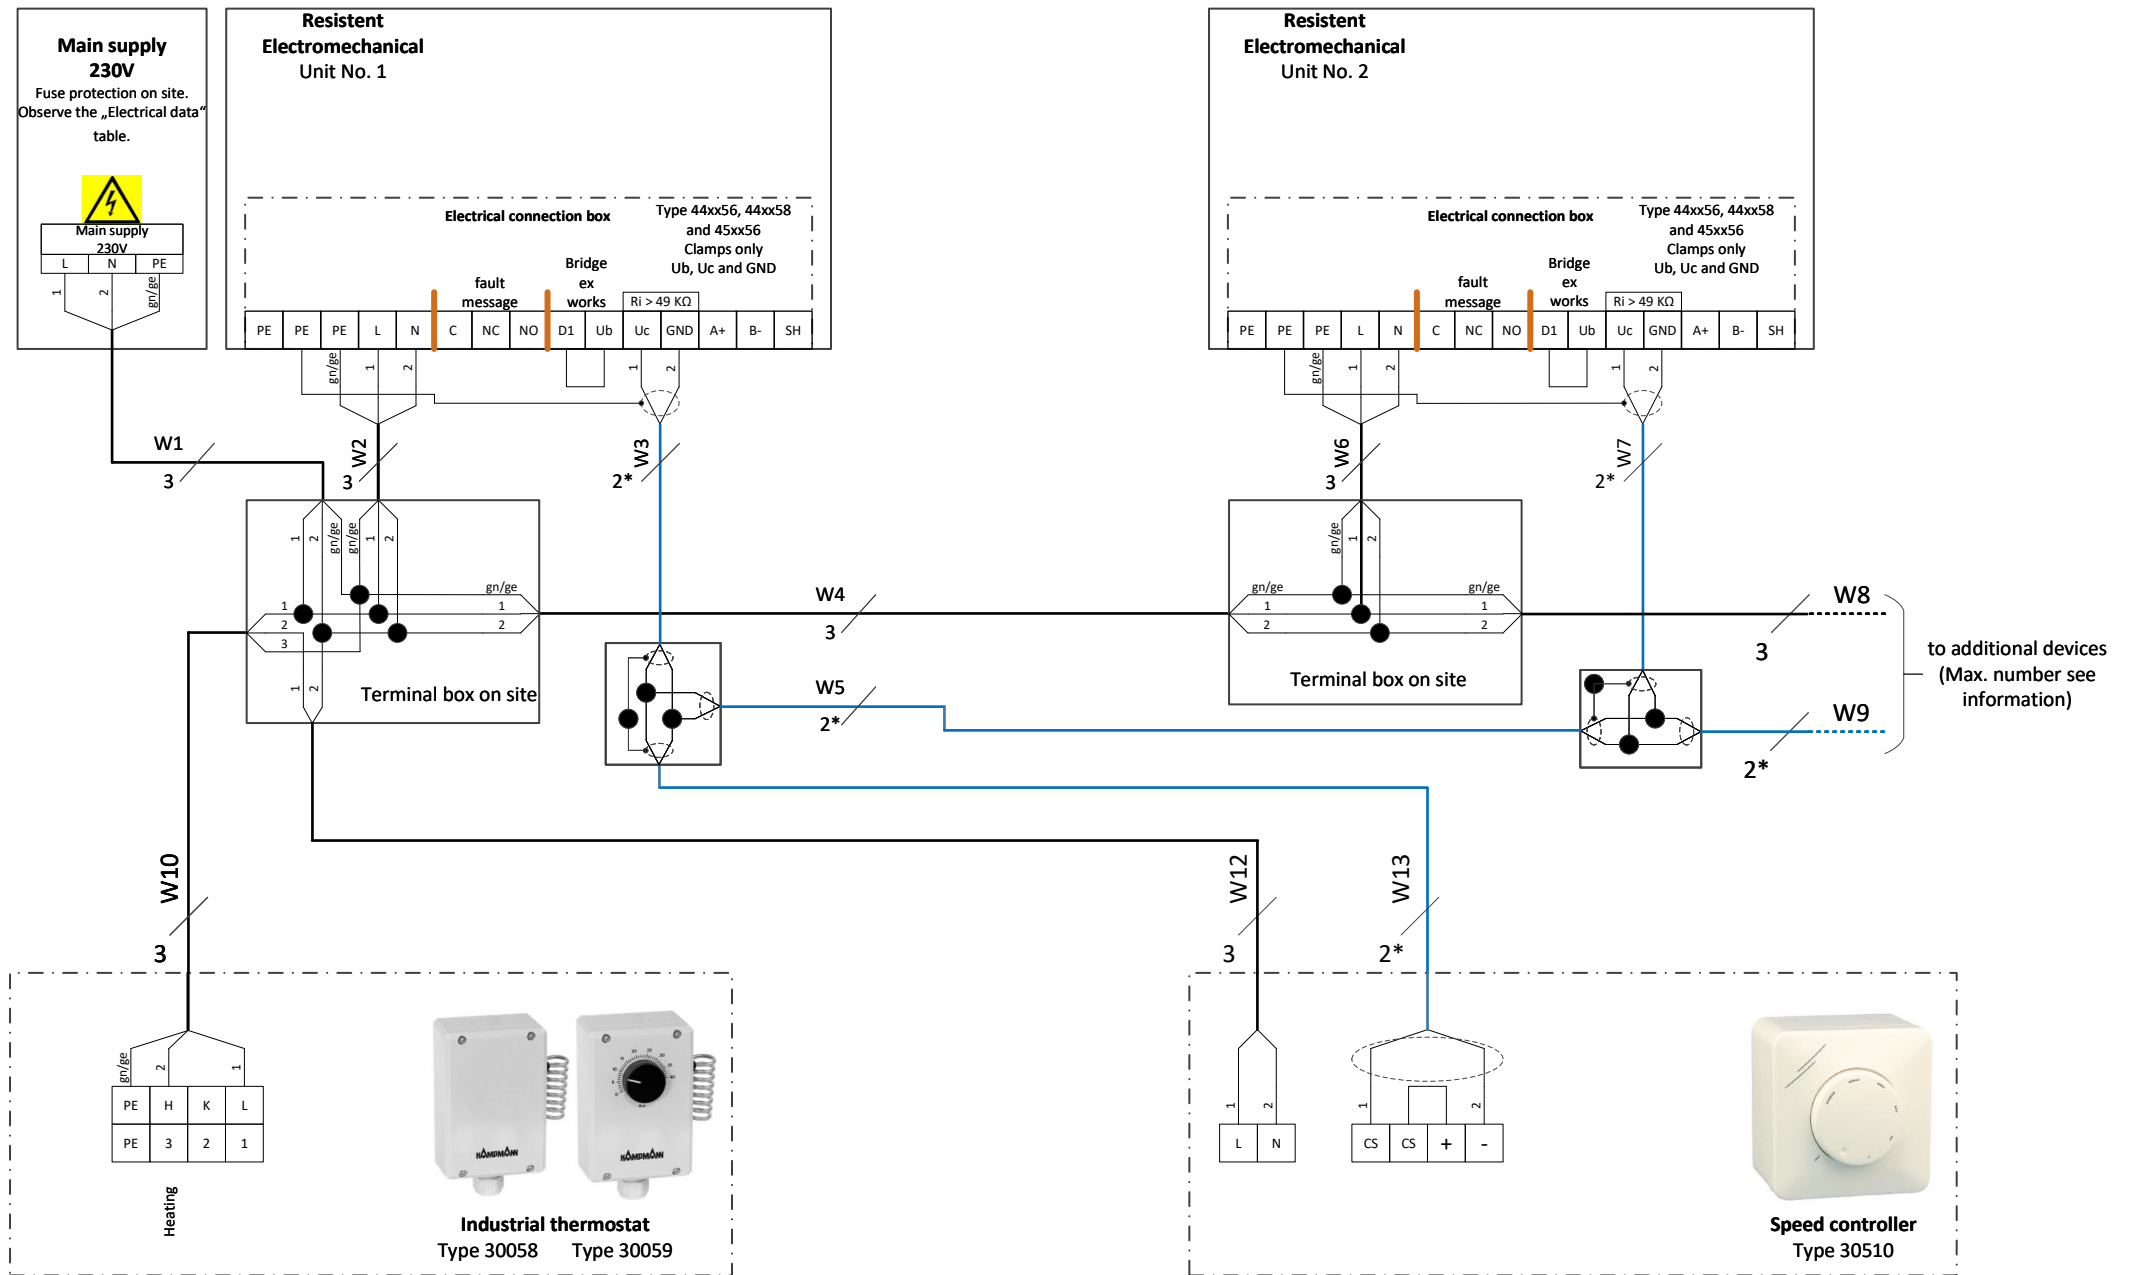


	Bearbeiter:	Projekt: Test, Ort	Resistent, Electromechanical, Speed controller Type 30510 with Industrial thermostat Type 30058/30059	Blatt-Nr.:	 Genau mein Klima.
	Erstelldatum: 06.02.2024	Projekt-Nr.:		4 von 11	

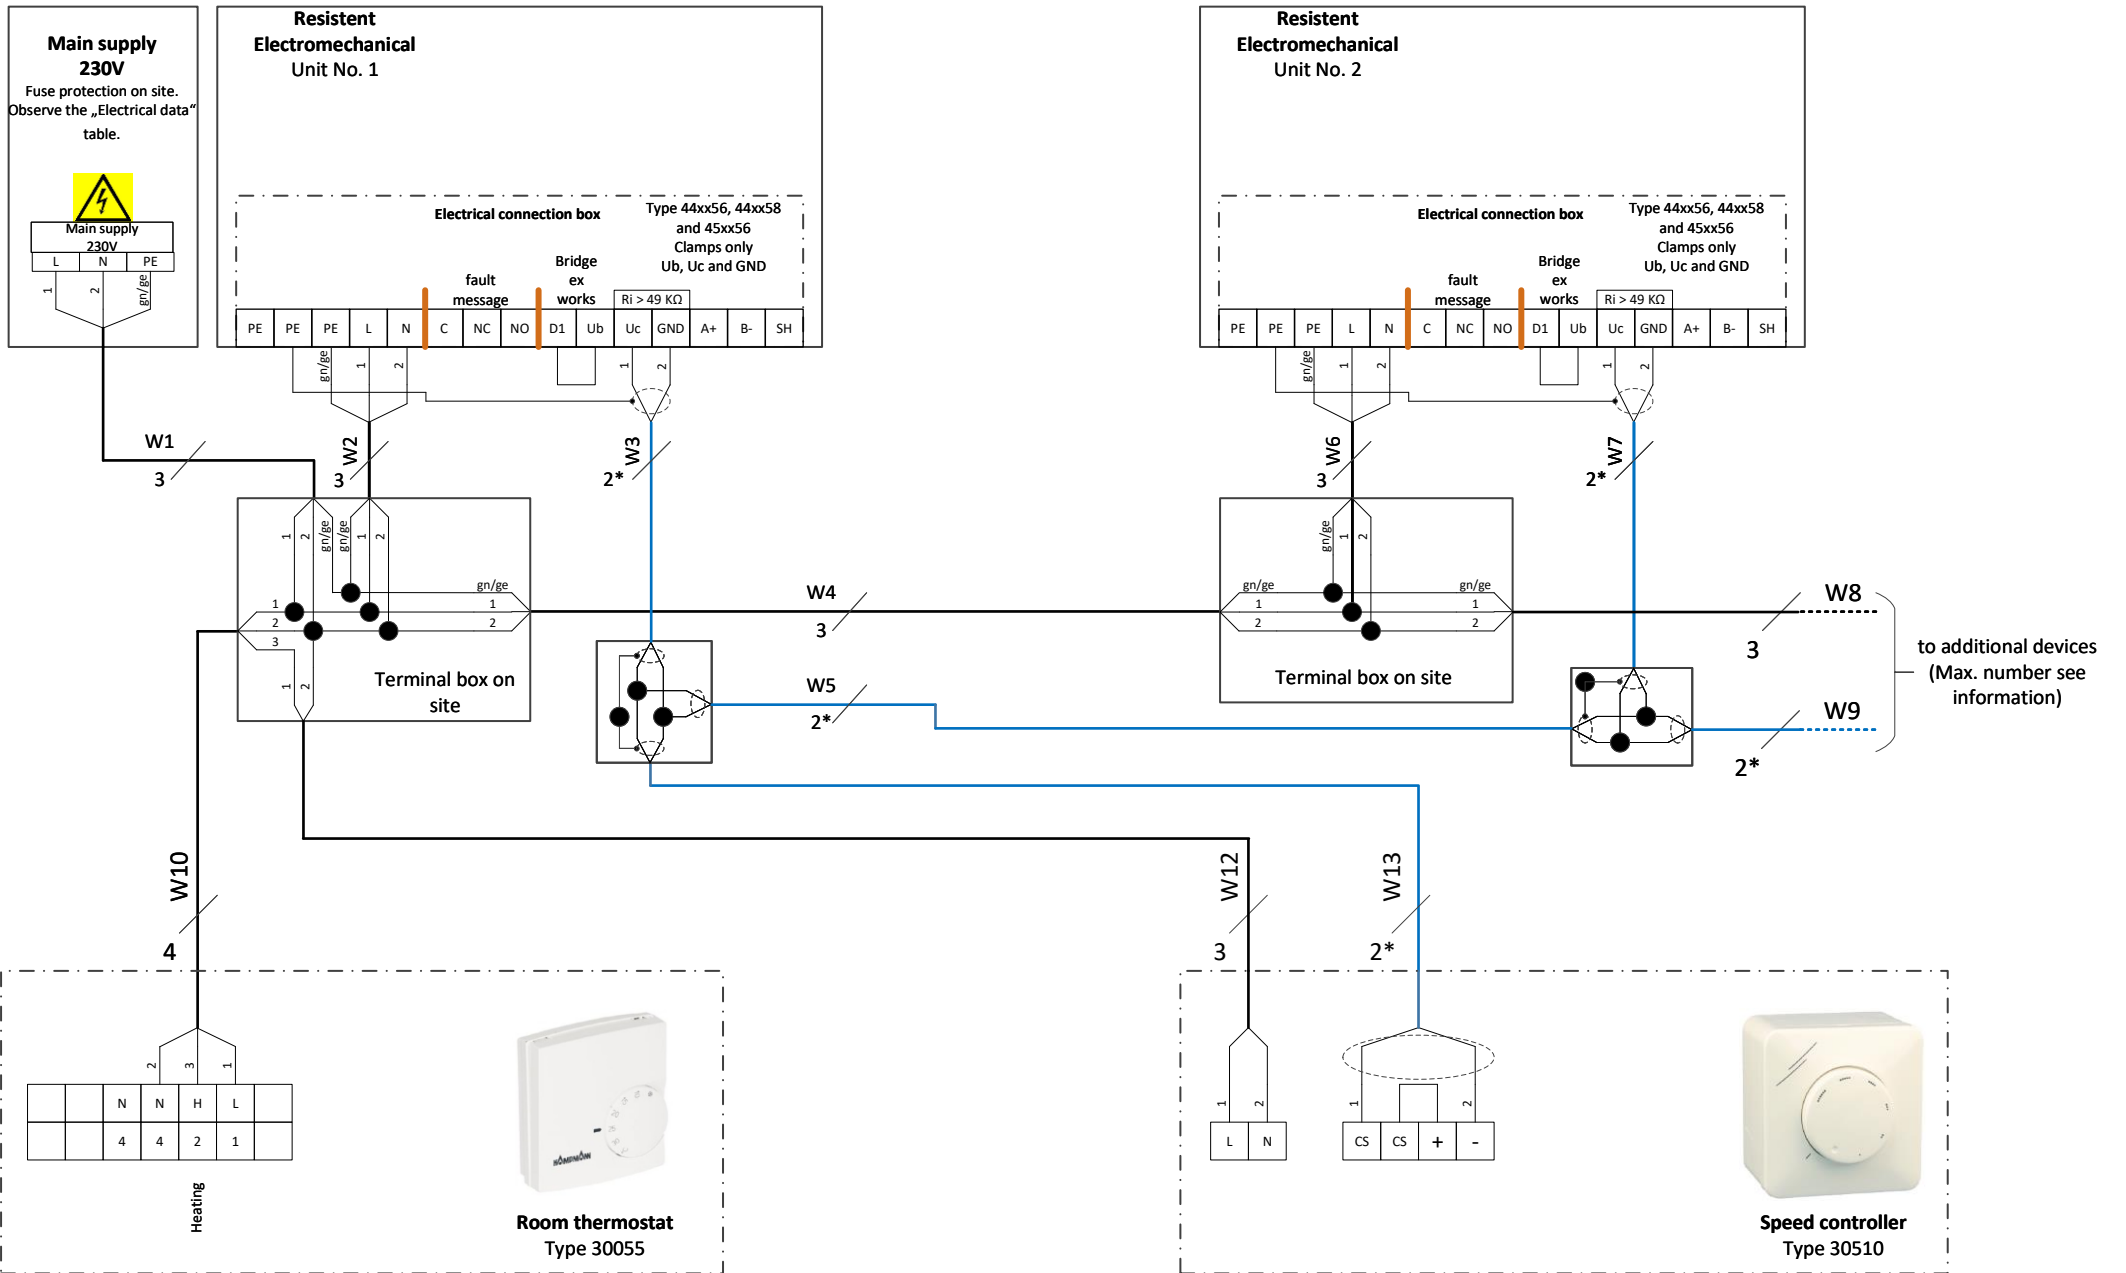

Bearbeiter: Erstdatum: 06.02.2024	Projekt: Test, Ort	Resistent, Electromechanical, Speed controller Type 30510 with Room thermostat Type 30055	Blatt-Nr.: 5 von 11	 Genau mein Klima.
	Projekt-Nr.:			



Bearbeiter: Erstellungsdatum: 06.02.2024	Projekt: Test, Ort	Resistent, Electromechanical, Speed controller Type 30510 with Clock thermostat Type 30056	Blatt-Nr.: 6 von 11	 Genau mein Klima.
	Projekt-Nr.:			

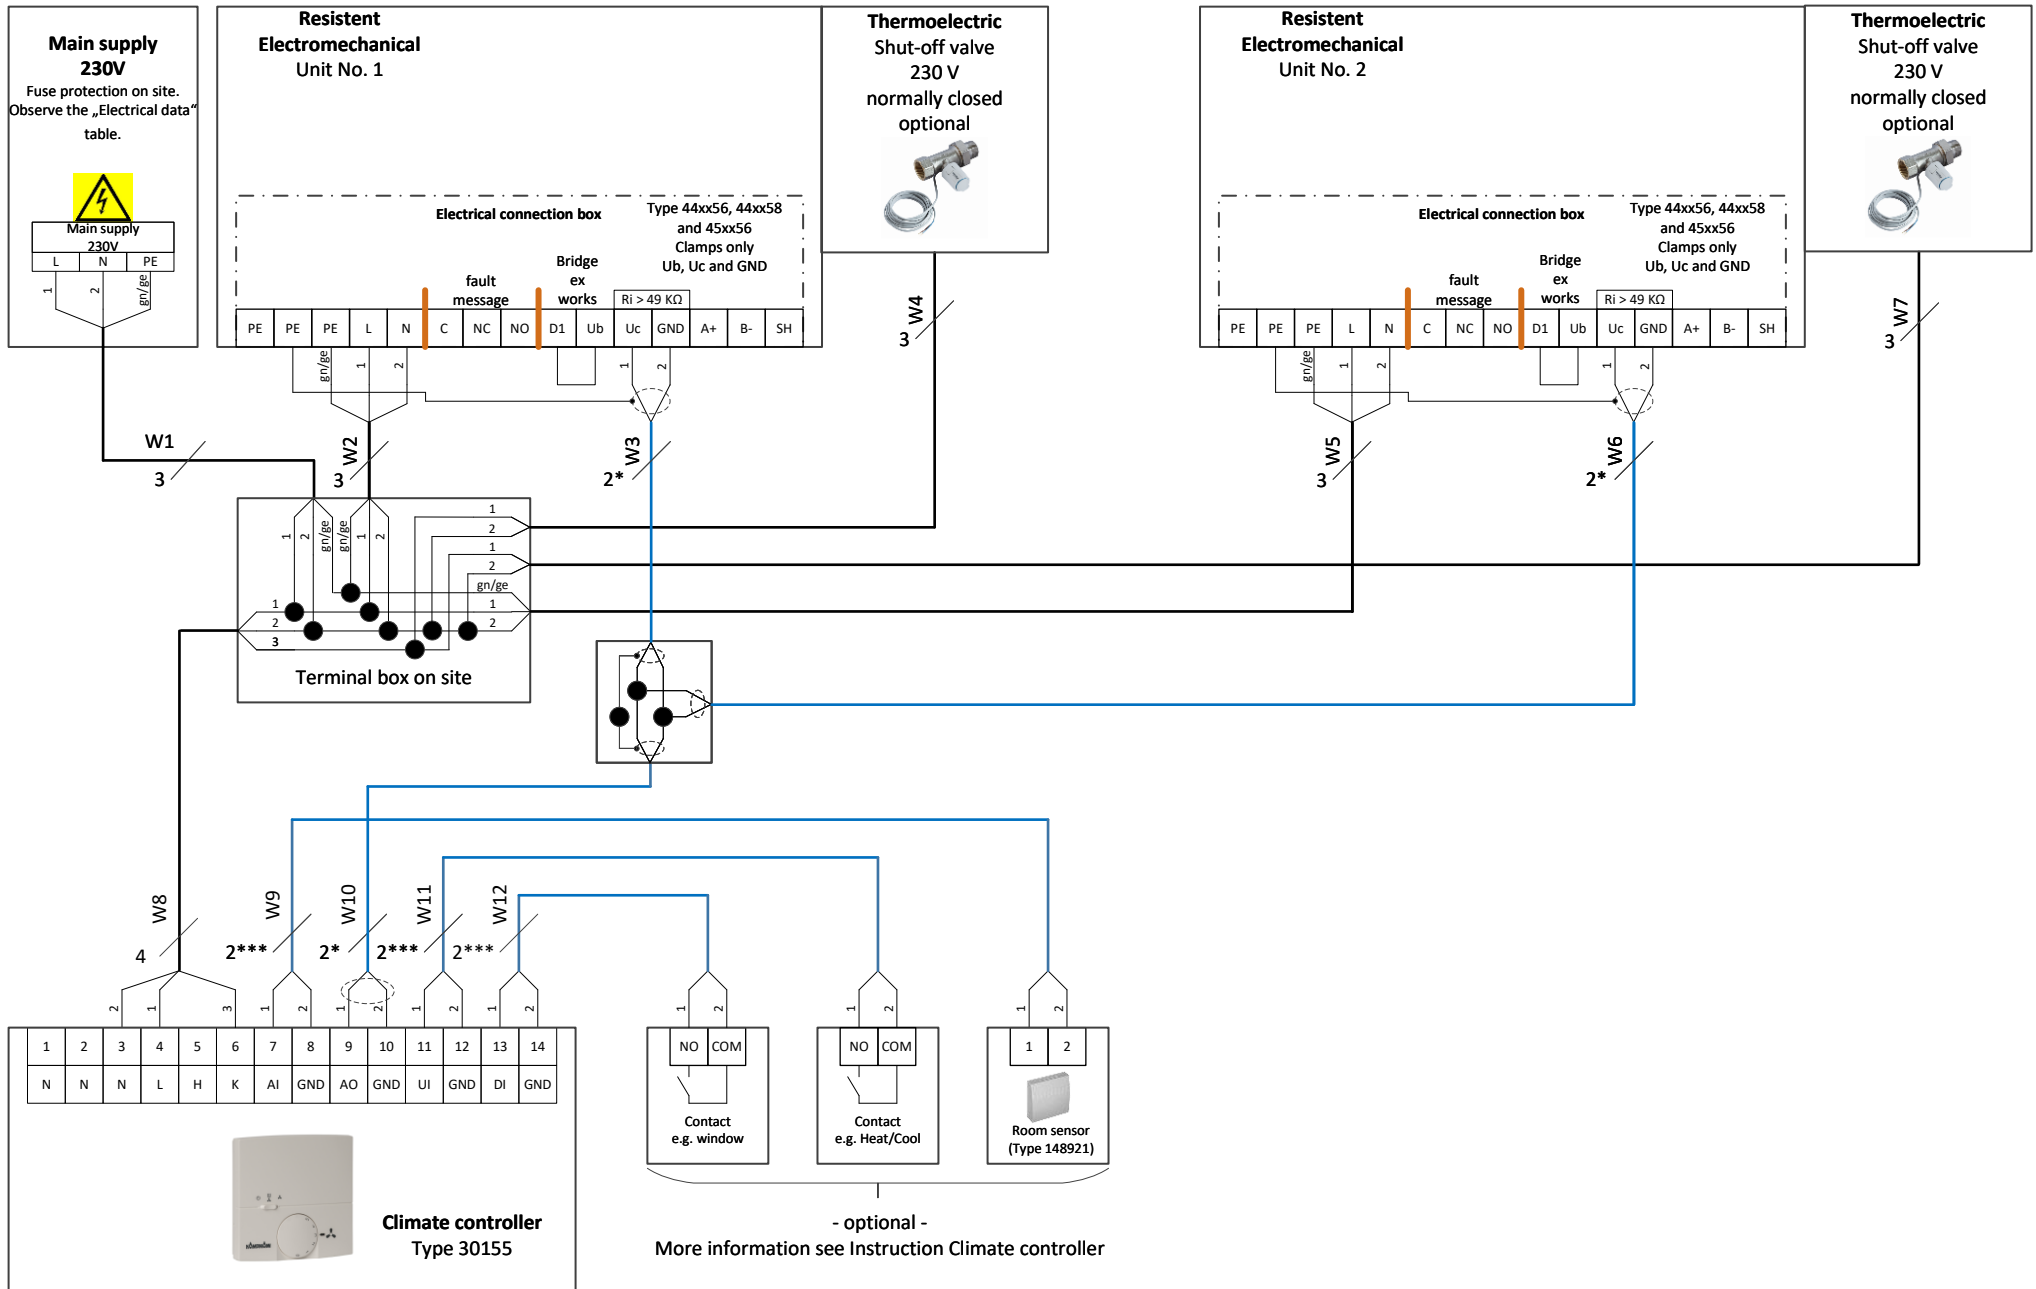


Bearbeiter:	Projekt: Test, Ort
Erstelldatum: 06.02.2024	Projekt-Nr.:

Resistant, electromechanical,  
2-wire valve actuator 230VAC, open/close  
Climate controller type 30155

Blatt-Nr.:  
7 von 11



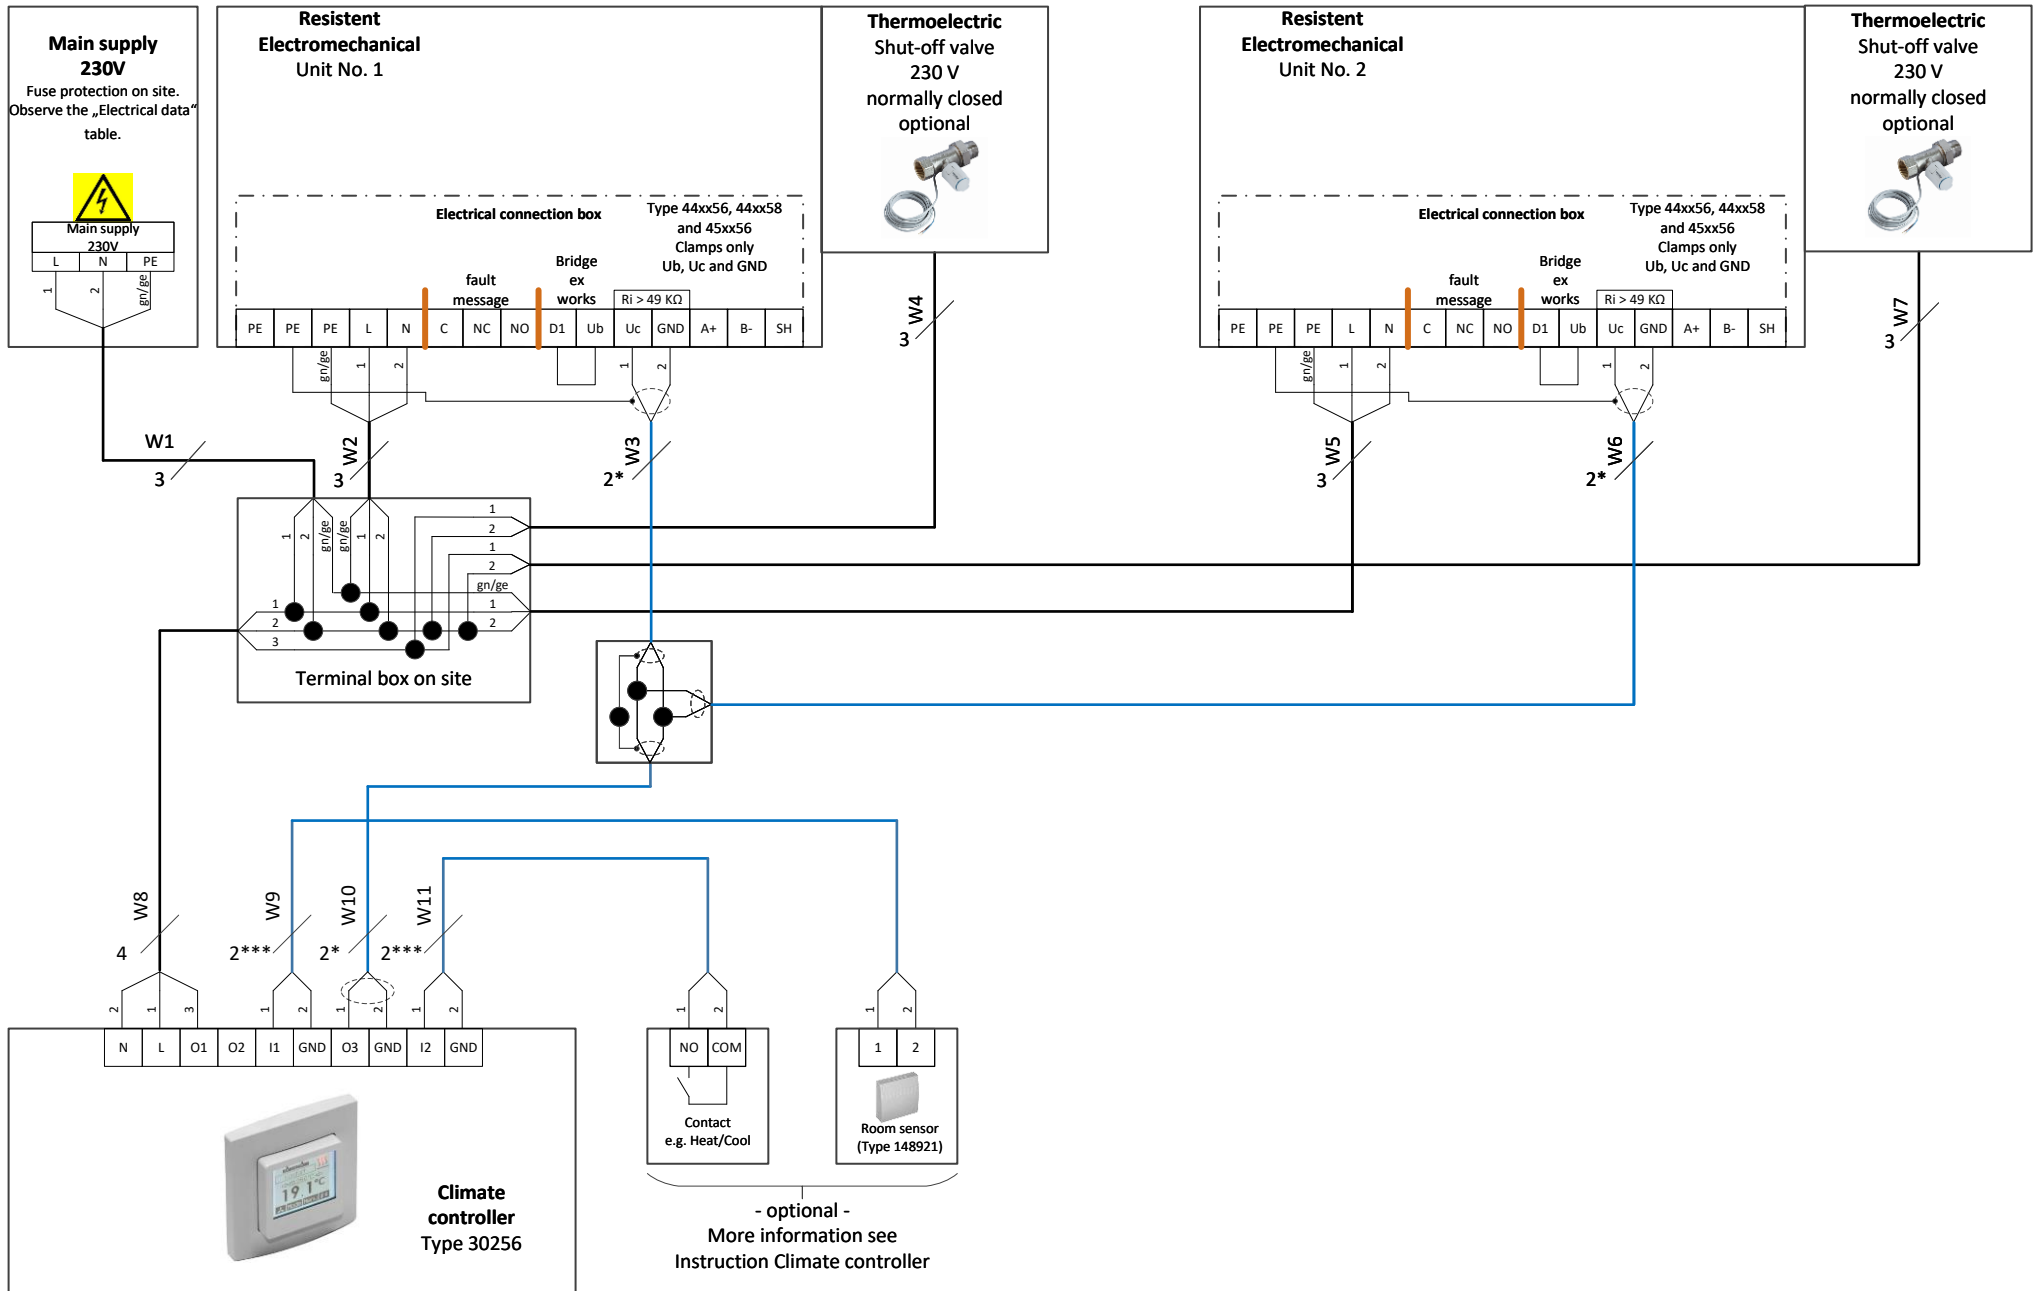


Bearbeiter:	Projekt: Test, Ort
Erstelldatum: 06.02.2024	Projekt-Nr.:

Resistent, Electromechanical,  
2-wire Valve actuator 230VAC, Open/Close  
Climate controller Type 30256

Blatt-Nr.:  
8 von 11






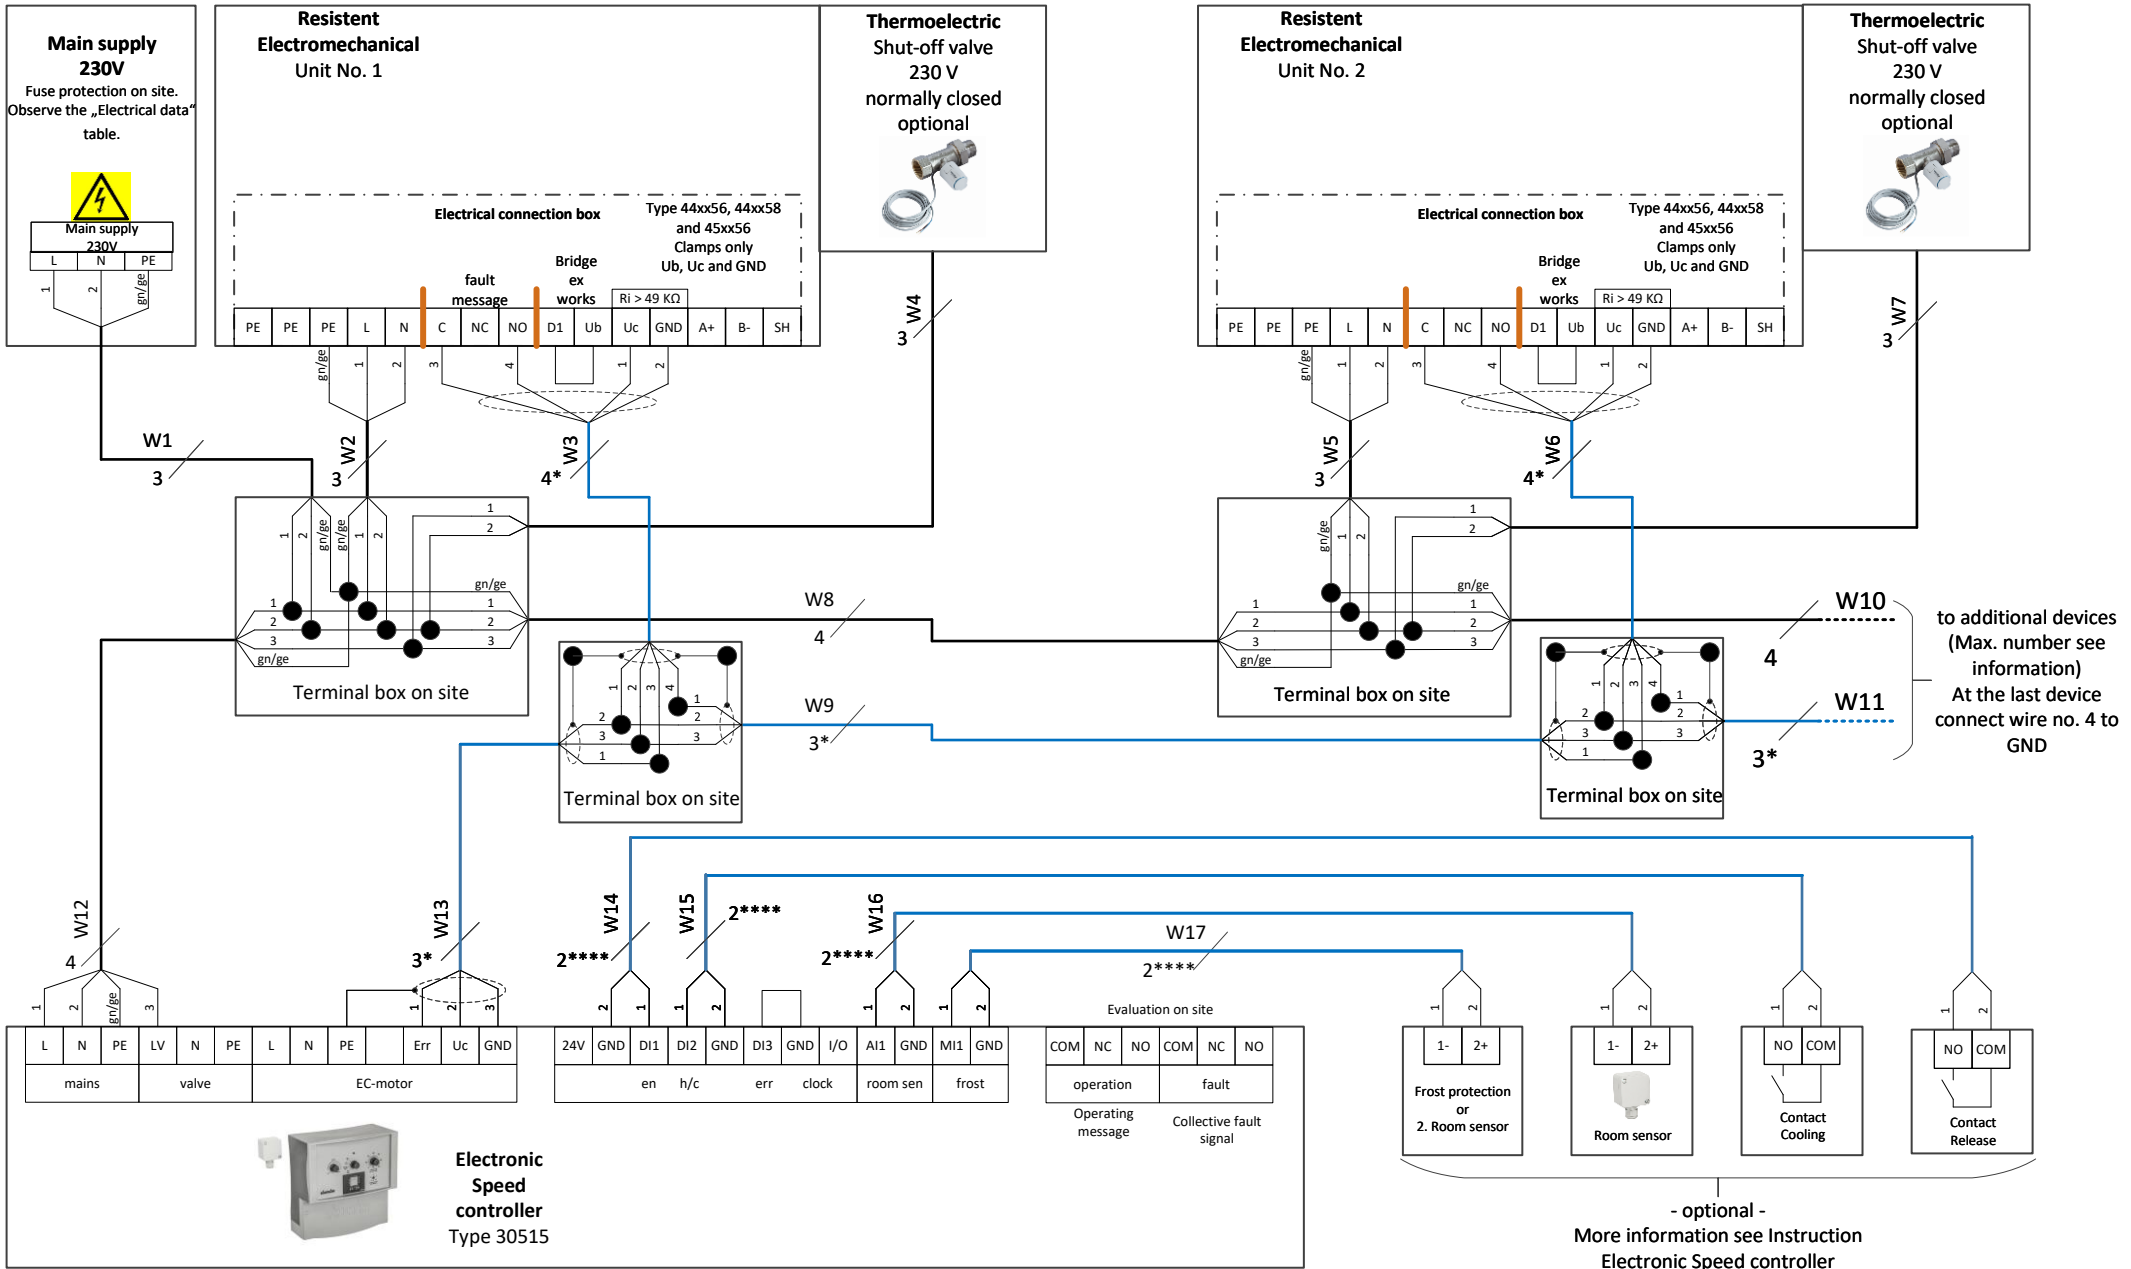

to additional devices  
(Max. number see information)  
At the last device connect wire no. 4 to GND

- optional -  
More information see Instruction  
Electronic Speed controller

Bearbeiter: Erstelldatum: 06.02.2024	Projekt: Test, Ort	Resistent, Electromechanical, Electronic Speed controller Type 30515	Blatt-Nr.: 9 von 11	 Genau mein Klima.
	Projekt-Nr.:			

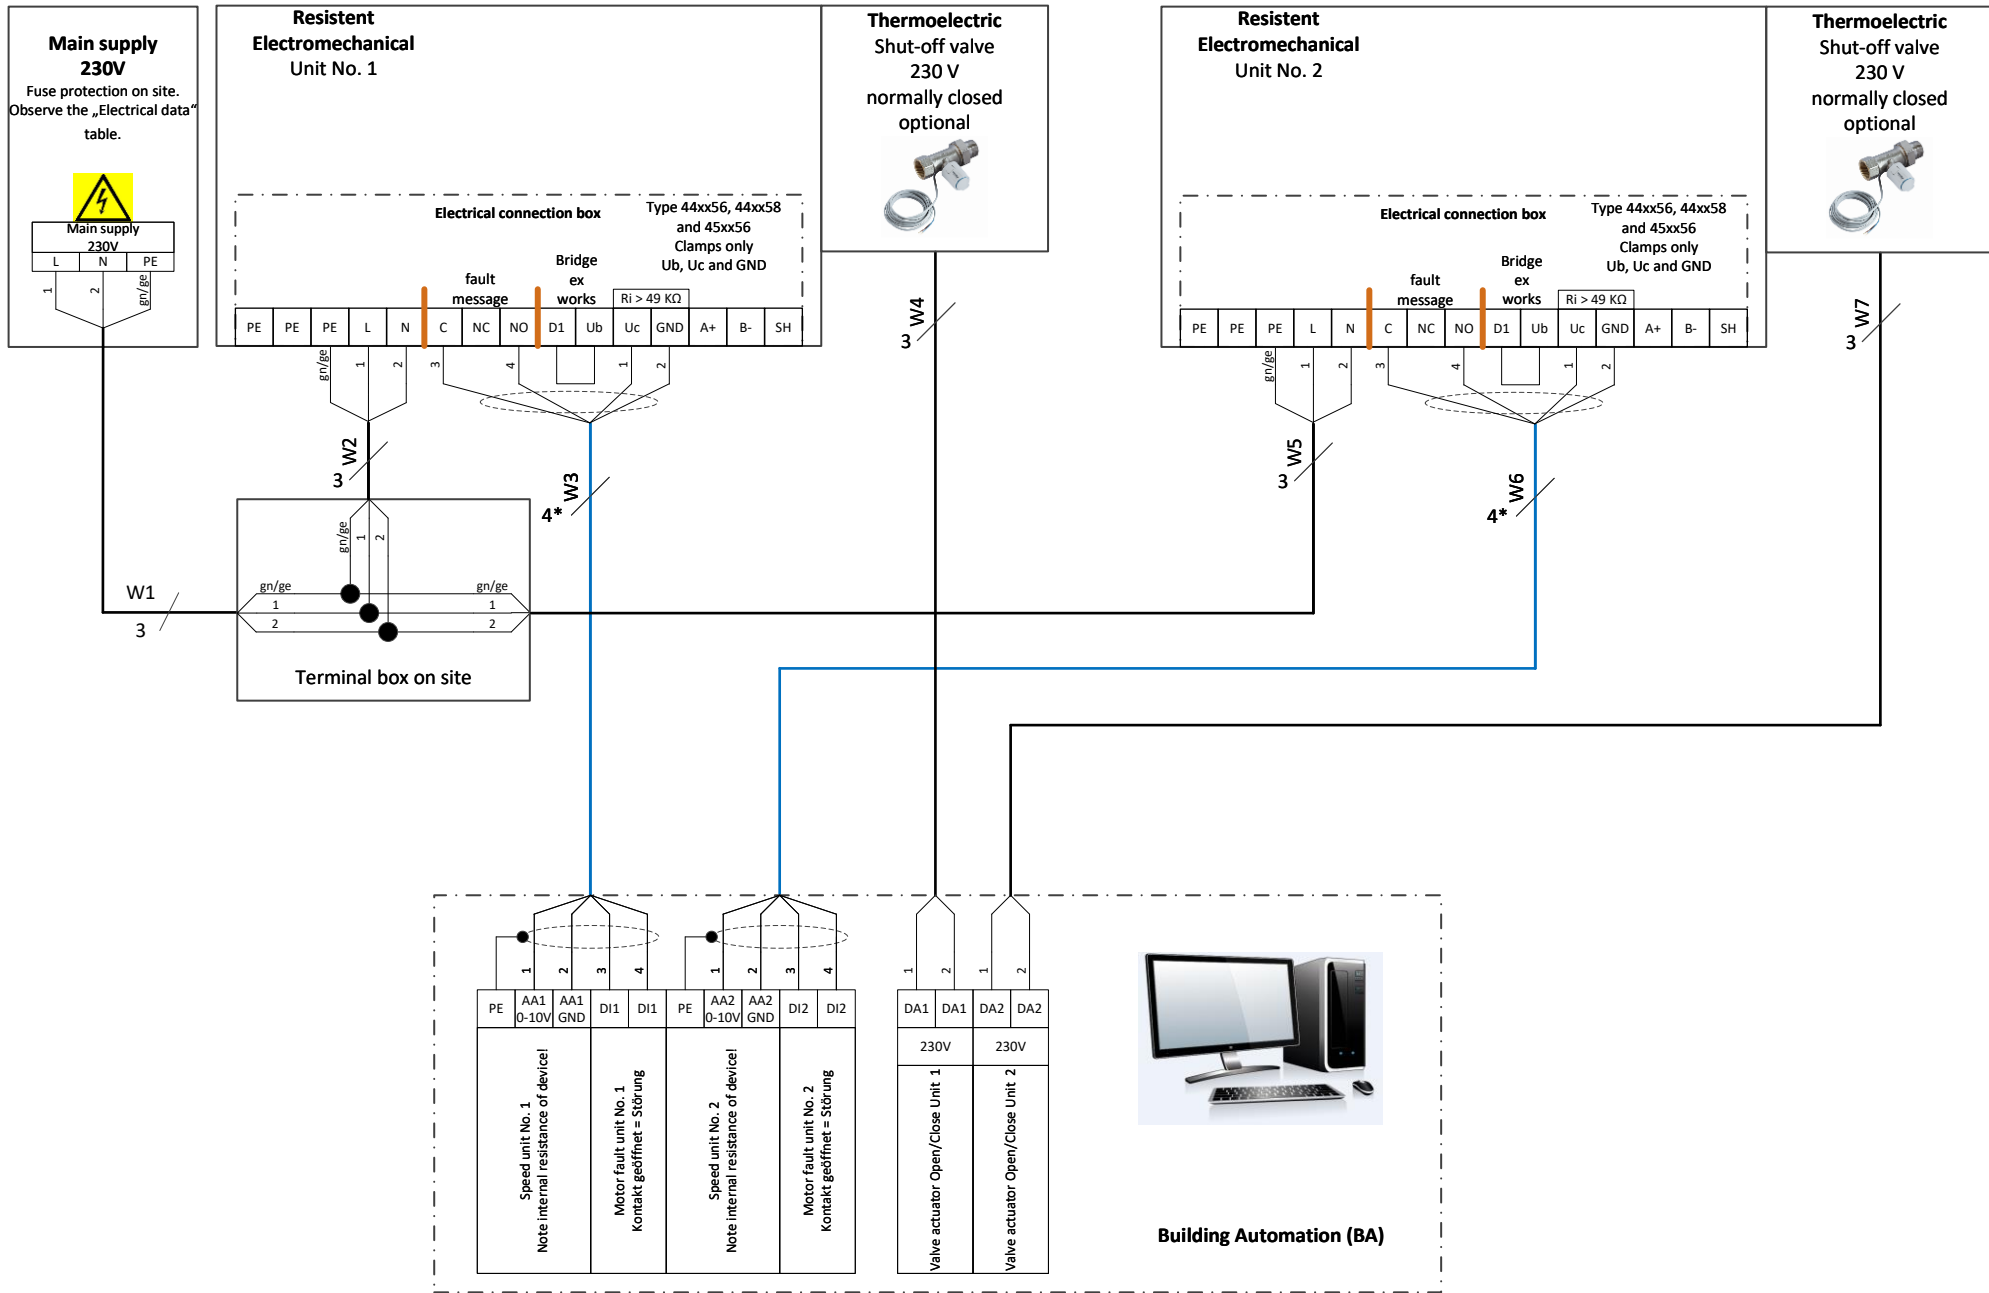

Bearbeiter: Erstdatum: 06.02.2024	Projekt: Test, Ort
	Projekt-Nr.:

Resistent, electromechanical,  
2-wire valve drive 230VAC, open/close  
Control via DDC/BA

Blatt-Nr.:  
10 von 11





**Kampmann GmbH & Co. KG**  
Friedrich-Ebert-Str. 128-130  
49811 Lingen (Ems)

**T** +49 591 7108-0  
**E** info@kampmann.de

[kampmanngroup.com](https://www.kampmanngroup.com)



**KAMPMAN**